


60' ROW

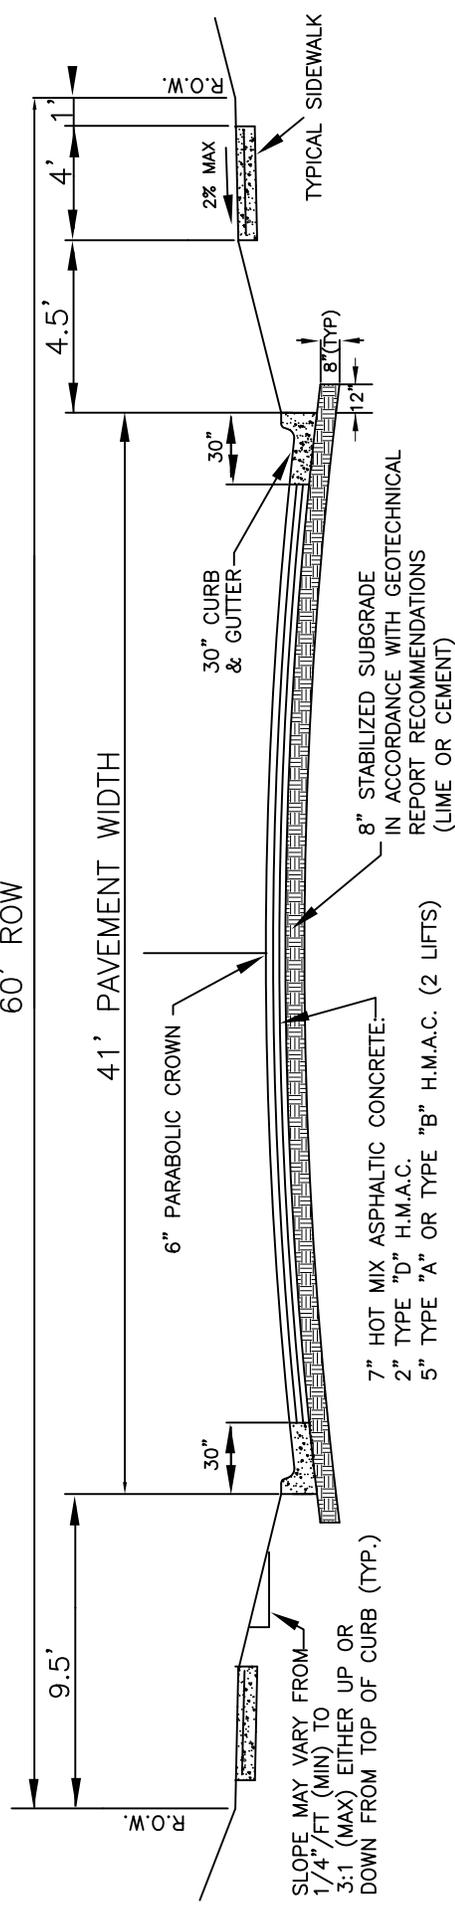

SLOPE MAY VARY FROM 1/4"/FT (MIN) TO 3:1 (MAX) EITHER UP OR DOWN FROM TOP OF CURB (TYP.)

7" HOT MIX ASPHALTIC CONCRETE:
 2" TYPE "D" H.M.A.C.
 5" TYPE "A" OR TYPE "B" H.M.A.C. (2 LIFTS)

8" STABILIZED SUBGRADE
 IN ACCORDANCE WITH GEOTECHNICAL
 REPORT RECOMMENDATIONS
 (LIME OR CEMENT)

NOTES:

1. GEOTECHNICAL REPORT (LIME SERIES TEST) PREPARED BY LICENSED ENGINEER IS REQUIRED TO DETERMINE LIME OR CEMENT APPLICATION RATE.
2. MINIMUM LIME APPLICATION RATE SHALL BE 30 LBS./S.Y.
3. SUBGRADE COMPACTION SHALL BE 95% STANDARD PROCTOR DENSITY.

| | |
|------------------|-------------------------------|
| P-06 | MINOR COLLECTOR (C3U) HMAC |
| CITY OF BURLESON | |
| ORIGINAL | 10/6/06 |
| REVISION | SWC |
| REVISION | |
| REVISION | |