



120' RIGHT-OF-WAY

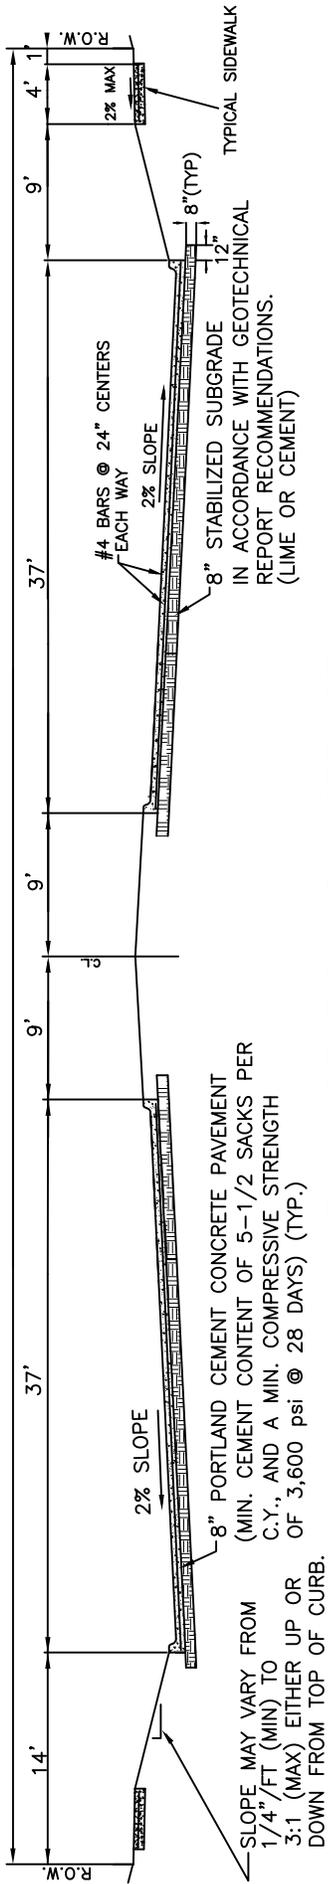

FULL SECTION CONSTRUCTION

120' RIGHT-OF-WAY

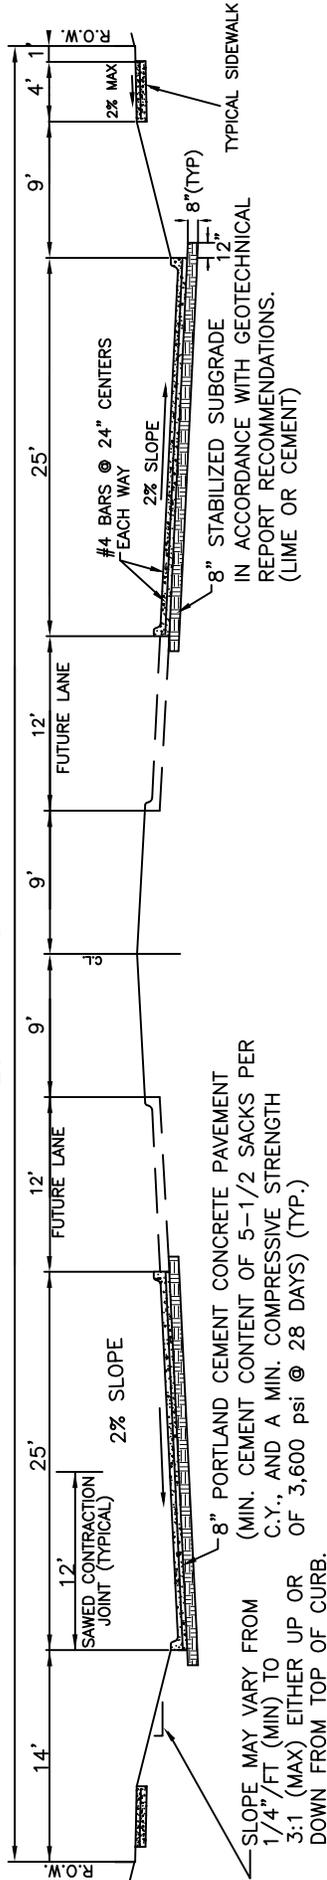

PROPOSED FUTURE WIDENING  
TO THE INSIDE

NOTES:

1. TRANSVERSE SAWED CONTRACTION JOINTS AT 15' INTERVALS & LONGITUDINAL SAWED CONTRACTION JOINTS AT 12' FROM OUTSIDE BACK OF CURBS.
2. GEOTECHNICAL REPORT (LIME SERIES TEST) PREPARED BY LICENSED ENGINEER IS REQUIRED TO DETERMINE LIME OR CEMENT APPLICATION RATE.
3. MINIMUM LIME APPLICATION RATE SHALL BE 30 LBS./S.Y.
4. SUBGRADE COMPACTION SHALL BE 95% STANDARD PROCTOR DENSITY.

P-10	PRINCIPAL ARTERIAL CONVENTIONAL (P6D)
CITY OF BURLESON	
ORIGINAL	10/6/06
REVISION	SWC
REVISION	
REVISION	