


SEPARATE CURB & GUTTER

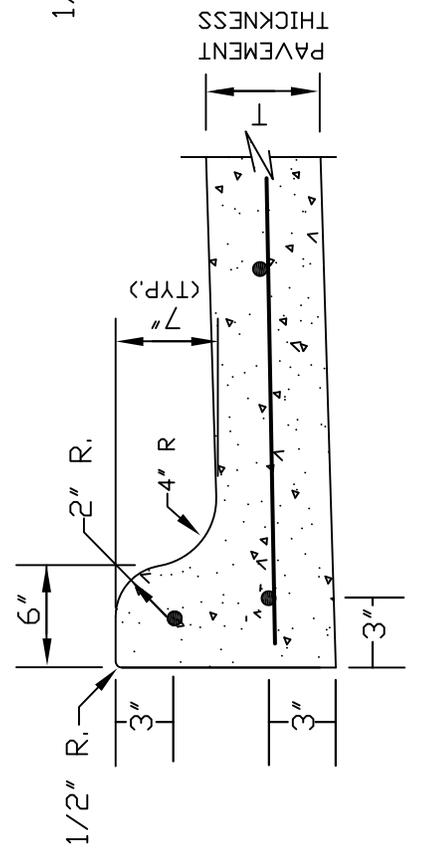

INTEGRAL CONCRETE CURB & GUTTER

NOTES:

1. REINFORCEMENT SHALL BE NO. 4 BARS.
2. CONCRETE SHALL BE 5 1/2 SACK - 3600 PSI.

P-14	CURB AND GUTTER
CITY OF BURLESON	
ORIGINAL	10/6/06
REVISION	SWC
REVISION	
REVISION	